



DOOR OPENING DETAILS

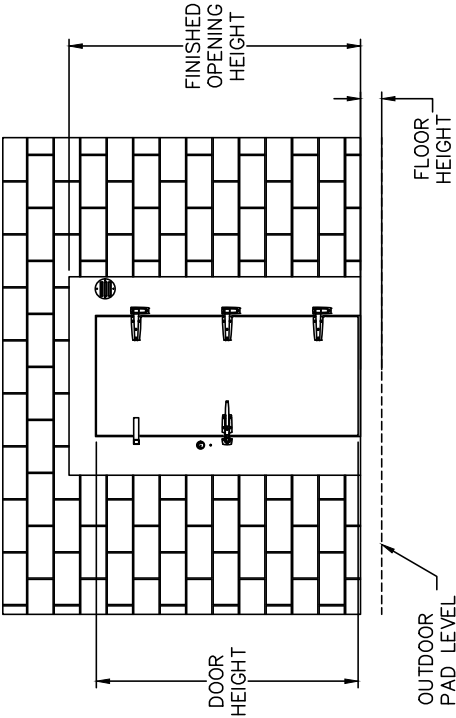

HEIGHT OF OPENING TO BE MINIMUM 8"
 GREATER THAN DOOR HEIGHT
 (SEE APPROVAL PRINT FOR DOOR DIMENSIONS)

| DOOR HEIGHT | FINISHED OPENING HEIGHT |
|-------------|-------------------------|
| 24" | 32" |
| 36" | 44" |
| 72" | 80" |
| 79" | 86" |

(HEIGHT OF OPENING TO BE APPROXIMATELY
 8" GREATER THAN DOOR HEIGHT)

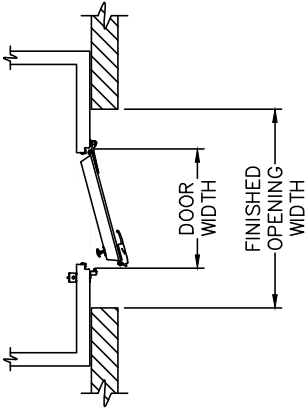

RECOMMENDED MINIMUM OF 12" ON BOTH
 SIDES OF DOORS
 (SEE APPROVAL PRINT FOR DOOR DIMENSIONS)

*FINISHED OPENING WIDTH TO BE LARGER IF TEMPERATURE
 MONITORS OR OTHER EQUIPMENT IS TO BE MOUNTED
 ON THE LATCH SIDE OF THE DOOR.

| DOOR WIDTH | FINISHED OPENING WIDTH |
|------------|------------------------|
| 24" | 48" |
| 30" | 54" |
| 36" | 60" |
| 48" | 72" |



All diagrams are available in larger format online in our resource center at www.polarking.com